


NOTES:

- 1) EXACT MOUNTING DETAILS TO BE DETERMINED AT JOBSITE BY OTHERS.
- 2) CALCULATIONS DO NOT SHOW THE EFFECT OF SHADOWING CAUSED BY OBJECTS WITHIN THE AREA.

**BASEBALL TYPICAL
PONY LEAGUE
CLASS II, 4 OUTFIELD POLES
250' RADIUS, 75' BASELINE
REF. NO. BASEII425075**

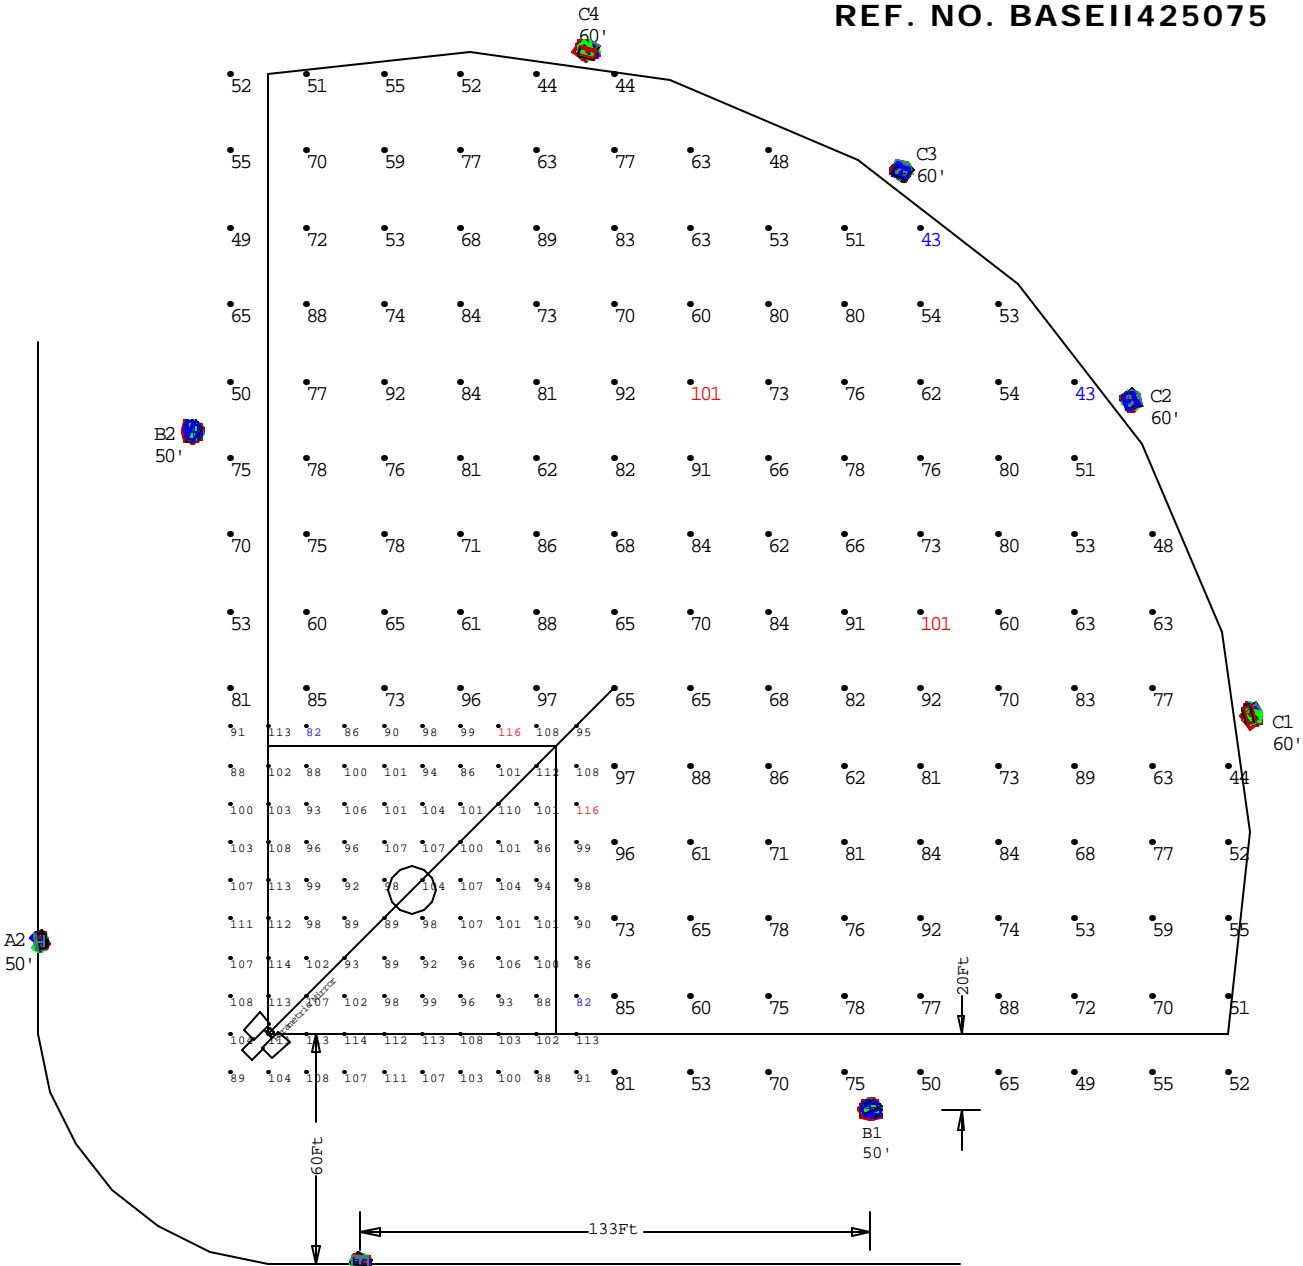

Luminaire Schedule						
Project: All Projects						
Symbol	Qty	Label	Description	Lumens	LLF	Filename
	42	F1	9000-XS-1000MH-TS	110000	0.720	lkmh1010.ies
	52	F2	9000-VN-1000MH	110000	0.720	lkmh3030.ies
	28	F3	9000-VN-1000MH	110000	0.720	9000VW1000MH.IES
	20	F6	9000-VW-1000MH	110000	0.720	9000VW1000MH.IES

Numeric Summary - Basic									
Project: All Projects									
Label	CalcType	Unit	Avg	Max	Min	Avg/Min	Max/Min	# Pt	Description
INFIELD	Illuminance	Fc	100.80	116	82	1.23	1.41	100	readings taken at 3' hfg
OUTFIELD	Illuminance	Fc	70.32	101	43	1.64	2.35	143	readings taken at 3 f.

View_1:Plan Rotated 0 Tilted 0
Scale: 1 inch= 50 Ft.



ABS LIGHTING- This layout provided using manufacturer's photometrics. Variations between installation and this layout will result in variations from footcandle levels shown.

Fixture Breakdown per Pole

File: BASEII425075

9000-XS-1000MH	9000-VN-1000MH	9000-VM-1000MH	9000-VW-1000MH
F1	F2	F3	F6

Pole	Mtg. Ht.	F1	F2	F3	F6
A1	50	3	5	5	3
A2	50	3	5	5	3
B1	50	8	14	3	2
B2	50	8	14	3	2
C1	60	7	3	4	3
C2	60	3	4	2	2
C3	60	3	4	2	2
C4	60	7	3	4	3
Total		42	52	28	20