


NOTES:

- 1) EXACT MOUNTING DETAILS TO BE DETERMINED AT JOBSITE BY OTHERS.
- 2) CALCULATIONS DO NOT SHOW THE EFFECT OF SHADOWING CAUSED BY OBJECTS WITHIN THE AREA.

**BASEBALL TYPICAL
YOUTH LEAGUE
CLASS IV, 2 OUTFIELD POLES
180' RADIUS, 60' BASELINE
REF. NO. BASEIV218060**

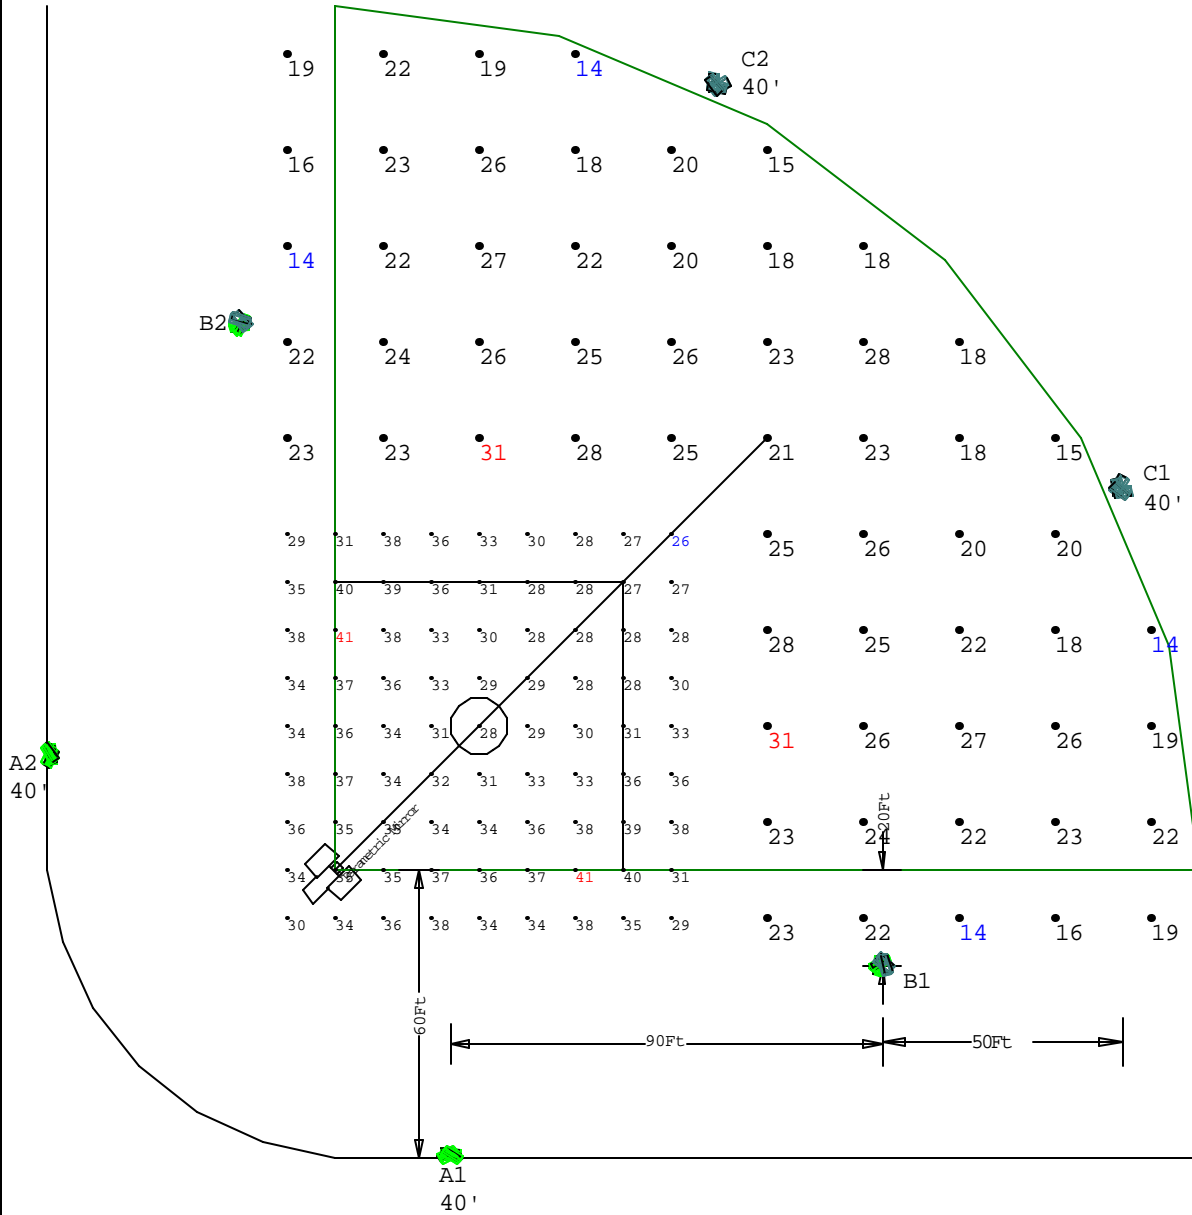

Luminaire Schedule						
Project: All Projects						
Symbol	Qty	Label	Description	Lumens	LLF	Filename
F3	14	F3	9000-VM-1000MH	110000	0.720	9000VM1000MH.IES
F6	12	F6	9000-VW-1000MH	110000	0.720	9000VW1000MH.IES

Numeric Summary - Basic										
Project: All Projects										
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min	# Pts	CV	Description
Infield	Illuminance	Fc	33.33	41	26	1.28	1.58	81	0.12	3' above grade
outfield	Illuminance	Fc	21.84	31	14	1.56	2.21	58	0.15	3' above grade

View_1:Plan Rotated 0 Tilted 0

Scale: 1 inch= 40 Ft.

ABS LIGHTING- This layout provided using manufacturer's photometrics. Variations between installation and this layout will result in variations from footcandle levels shown.



Fixture Breakdown per Pole

File: BASEIV218060

9000-XS-1000MH	9000-VN-1000MH	9000-VM-1000MH	9000-VW-1000MH
F1	F2	F3	F6

Pole	Mtg. Ht.				
A1	40			4	
A2	40			4	
B1	40			3	2
B2	40			3	2
C1	50				4
C2	50				4
Total			0	14	12