


NOTES:

- 1) EXACT MOUNTING DETAILS TO BE DETERMINED AT JOBSITE BY OTHERS.
- 2) CALCULATIONS DO NOT SHOW THE EFFECT OF SHADOWING CAUSED BY OBJECTS WITHIN THE AREA.

**BASEBALL TYPICAL
PONY. LEAGUE
CLASS IV, 4 OUTFIELD POLES
250' RADIUS, 75' BASELINE
REF. NO. BASEIV425075**

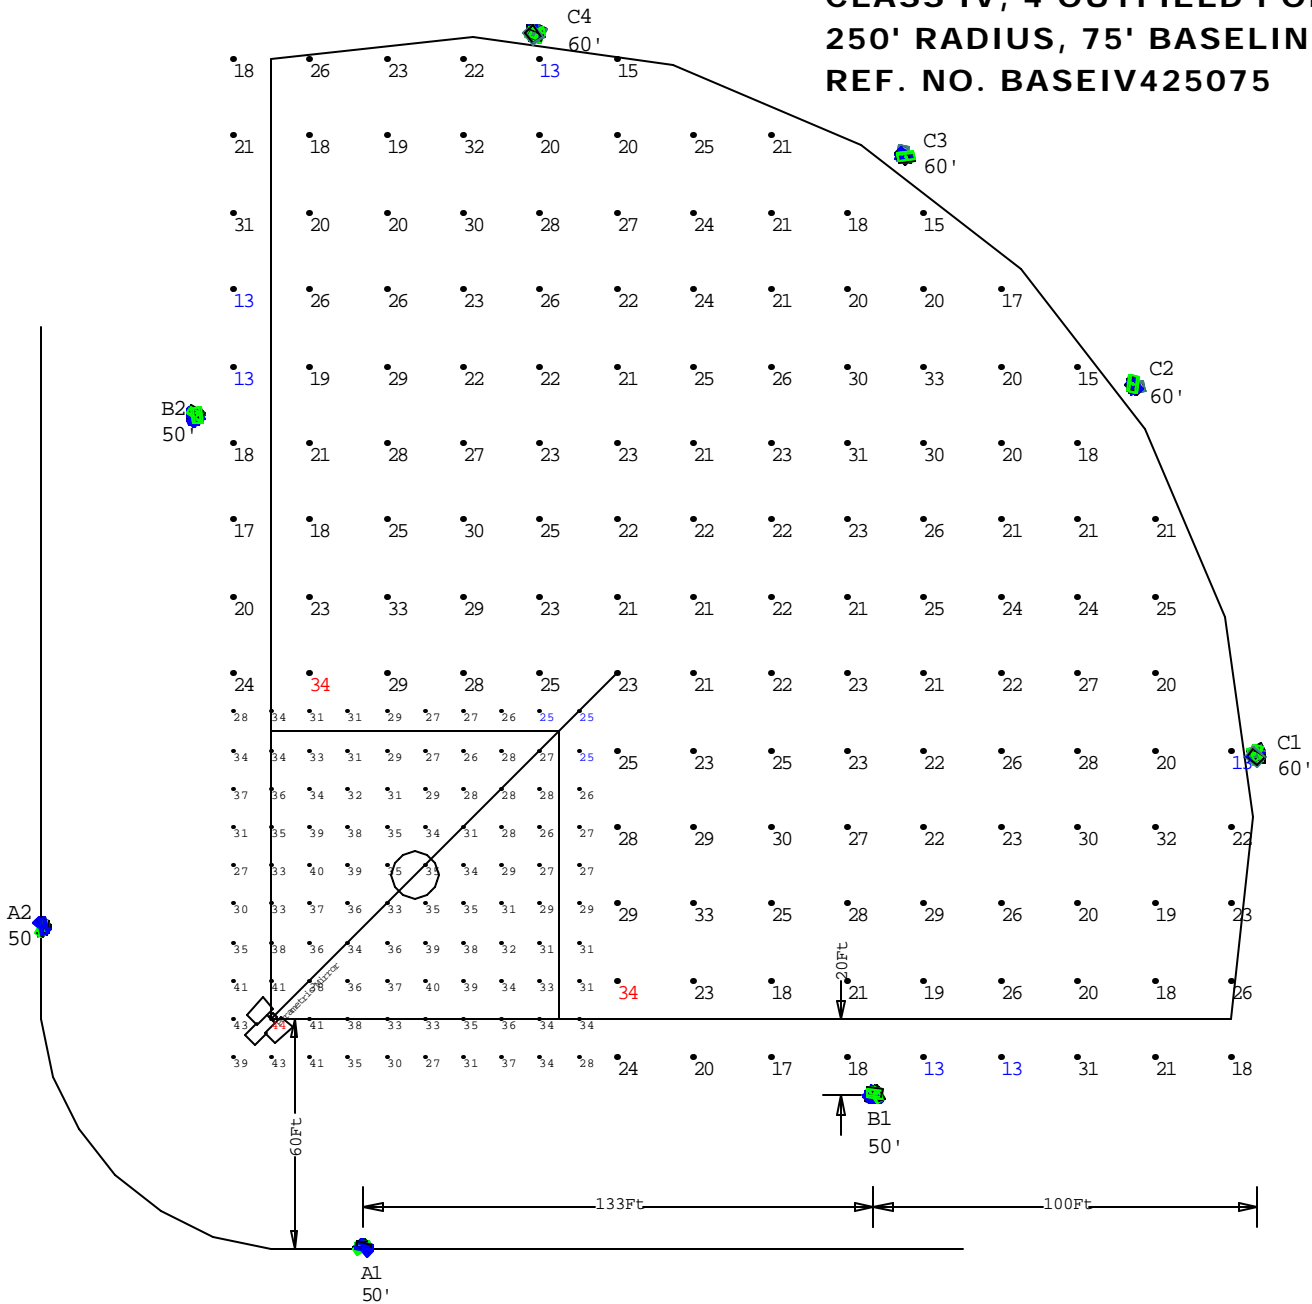

Luminaire Schedule						
Project: All Projects						
Symbol	Qty	Label	Description	Lumens	LLF	Filename
-	26	F2	9000-VN-1000MH	110000	0.720	1kmh3030.ies
-	14	F3	9000-VM-1000MH	110000	0.720	9000VM1000MH.IES
-	6	F6	9000-VW-1000MH	110000	0.720	9000VW1000MH.IES

Numeric Summary - Basic										
Project: All Projects										
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min	# Pts	CV	Description
OUTFIELD	illuminance	Fc	23.12	34	13	1.78	2.62	143	0.17	readings taken at 3 ft. afg
INFIELD	illuminance	Fc	33.00	44	25	1.32	1.76	100	0.14	readings taken at 3' afg

Scale: 1 inch= 50 Ft.

ABS LIGHTING- This layout provided using manufacturer's photometrics. Variations between installation and this layout will result in variations from footcandle levels shown.



Fixture Breakdown per Pole

File: BASEIV425075

9000-XS-1000MH	9000-VN-1000MH	9000-VM-1000MH	9000-VW-1000MH
F1	F2	F3	F6

Pole	Mtg. Ht.				
A1	50		4	2	
A2	50		4	2	
B1	50		6	2	
B2	50		6	2	
C1	60		1	2	2
C2	60		2	1	1
C3	60		2	1	1
C4	60		1	2	2
Total			26	14	6