


**NOTES:**

- 1) EXACT MOUNTING DETAILS TO BE DETERMINED AT JOBSITE BY OTHERS.
- 2) CALCULATIONS DO NOT SHOW THE EFFECT OF SHADOWING CAUSED BY OBJECTS WITHIN THE AREA.

**BASEBALL TYPICAL  
PONY LEAGUE  
CLASS IV, 6 OUTFIELD POLES  
250' RADIUS, 75' BASELINE  
REF. NO. BASEIV625075**

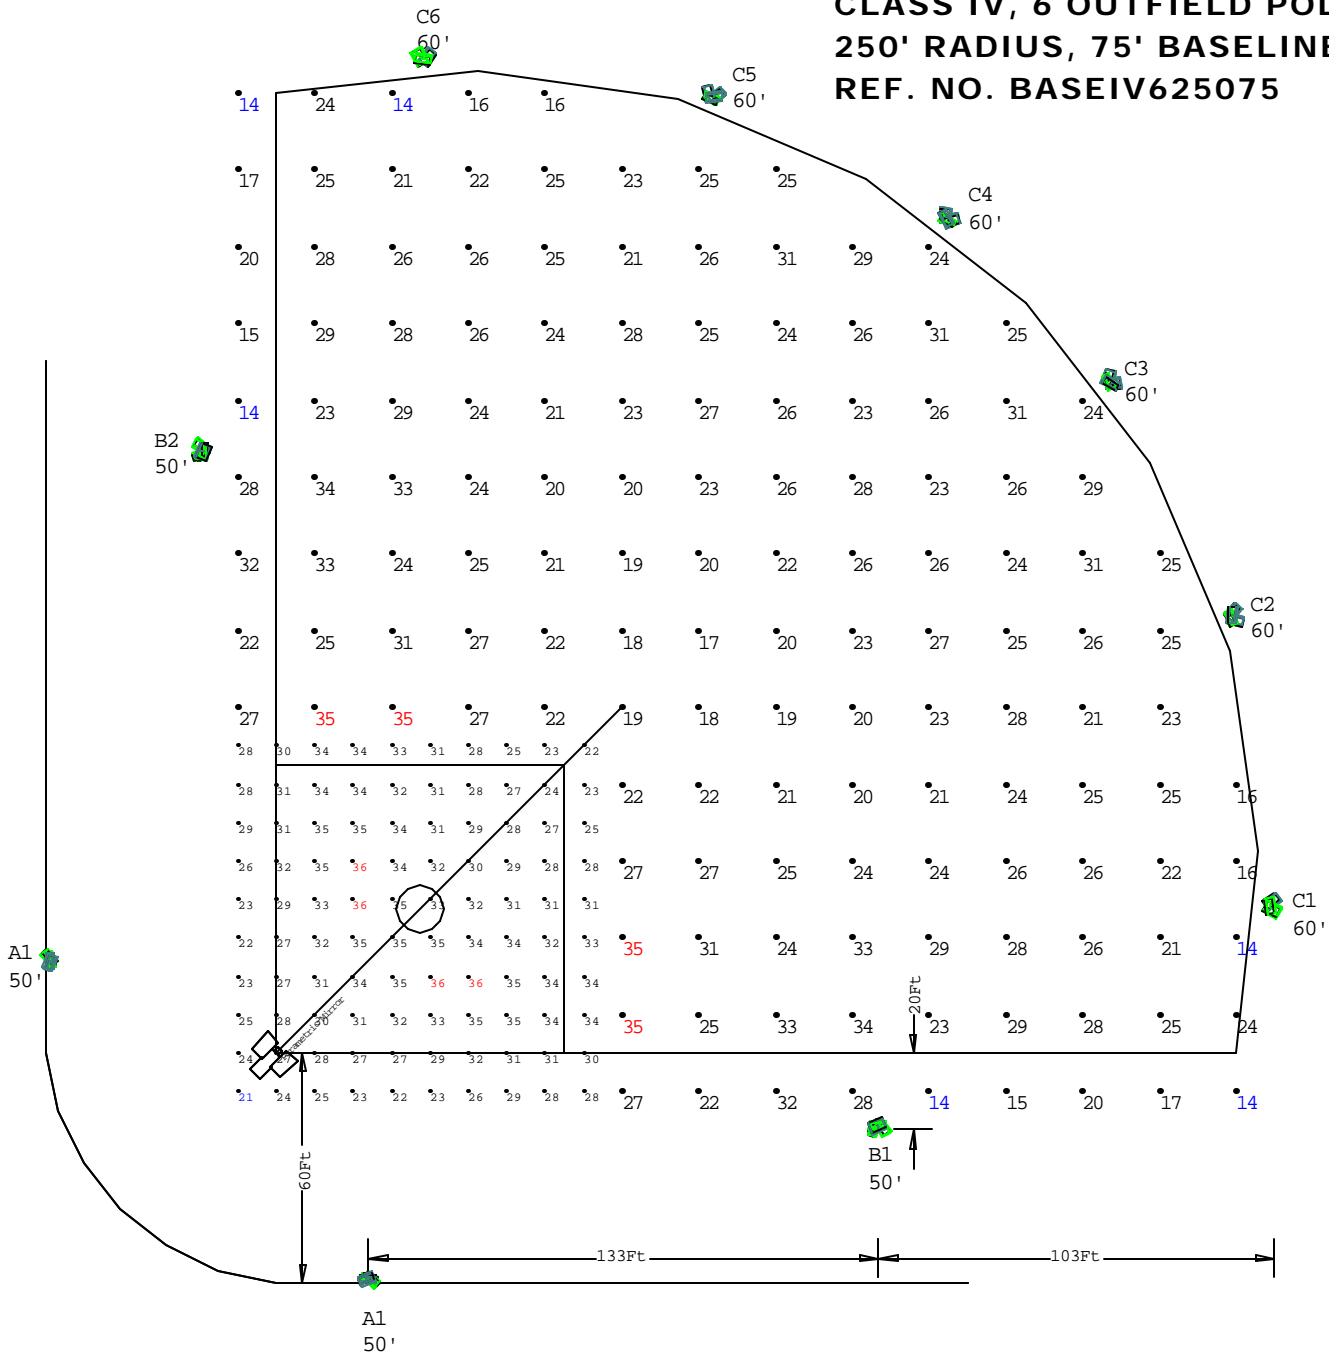

Luminaire Schedule						
Project: All Projects						
Symbol	Qty	Label	Description	Lumens	LLF	Filename
[Symbol]	26	F3	9000-VM-1000MH	110000	0.720	9000VM1000MH.IES
[Symbol]	20	F6	9000-VW-1000MH	110000	0.720	9000VW1000MH.IES

Numeric Summary - Basic										
Project: All Projects										
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min	# Pts	CV	Description
InField	Illuminance	Fc	30.04	36	21	1.43	1.71	100	0.13	3' above grade
Outfield	Illuminance	Fc	24.37	35	14	1.74	2.50	142	0.17	3' above grade

View\_1:Plan Rotated 0 Tilted 0  
Scale: 1 inch= 50 Ft.

ABS LIGHTING- This layout provided using manufacturer's photometrics. Variations between installation and this layout will result in variations from footcandle levels shown.



# Fixture Breakdown per Pole

File: BASEIV625075

9000-XS-1000MH	9000-VN-1000MH	9000-VM-1000MH	9000-VW-1000MH
F1	F2	F3	F6

Pole	Mtg. Ht.	F1	F2	F3	F6
A1	50			3	2
A2	50			3	2
B1	50			6	1
B2	50			6	1
C1	60			2	1
C2	60			1	3
C3	60			1	3
C4	60			1	3
C5	60			1	3
C6	60			2	1
<b>Total</b>				<b>26</b>	<b>20</b>